

Energetic and Exergetic Performances Simulating of GSHP Greenhouse Cooling System in Northern China

Lilong Chai, Chengwei Ma, Gangyi Xu, Mingchi Liu, Yong Xu

► To cite this version:

Lilong Chai, Chengwei Ma, Gangyi Xu, Mingchi Liu, Yong Xu. Energetic and Exergetic Performances Simulating of GSHP Greenhouse Cooling System in Northern China. 5th Computer and Computing Technologies in Agriculture (CCTA), Oct 2011, Beijing, China. pp.74-84, 10.1007/978-3-642-27275-2_8. hal-01361121

HAL Id: hal-01361121

<https://hal.inria.fr/hal-01361121>

Submitted on 6 Sep 2016

HAL is a multi-disciplinary open access archive for the deposit and dissemination of scientific research documents, whether they are published or not. The documents may come from teaching and research institutions in France or abroad, or from public or private research centers.

L'archive ouverte pluridisciplinaire **HAL**, est destinée au dépôt et à la diffusion de documents scientifiques de niveau recherche, publiés ou non, émanant des établissements d'enseignement et de recherche français ou étrangers, des laboratoires publics ou privés.



Distributed under a Creative Commons Attribution| 4.0 International License

Energetic and Exergetic performances simulating of GSHP greenhouse cooling system in northern China

Lilong Chai¹, Chengwei Ma^{2*}, Gangyi Xu¹, Mingchi Liu¹, Yong Xu¹

1. Vegetable Research Center, Beijing Academy of Agriculture and Forestry Sciences, Beijing 100097, China; Email: lchai@purdue@gmail.com
2. College of Water Conservancy & Civil Engineering, China Agricultural University, Beijing 100083, China. Email: macwbs@cau.edu.cn

Abstract. The Energetic and Exergetic performances evaluating models were built for a agricultural greenhouse cooling with groundwater-style GSHP system (GSHPs) in Northern China. The Exergy destruction (Ex_{dest}), Exergy efficiency(ϵ) and coefficient of performance (COP) were estimated and presented based on summer cooling test monitored data and the simulation models. Analyzed results indicate that the evaporator has the highest Exergy efficiency compared with other sections of the system, which reached 92% during cooling test that means the evaporator has a brilliant performance of reversibility in cooling mode. The condenser and compressors have lower reversibility relatively. Generally, GSHPs has an Exergy efficiency of 36%. Besides, COP of GSHPs cooling in greenhouse reached 3.09, which is higher than 2.0 of conventional air source heat pump systems COP by 50%.

Keywords: greenhouse; Ground source heat pump; cooling; Exergy efficiency; COP

1 Introduction

The utilizing of renewable and clean energy source, such as solar energy and shallow geothermal energy for building air-conditioning were conducted more frequent with the strengthen of global warming and environmental pollutant [1-4]. The shallow geothermal energy (the solar energy stored in shallow soil layer and groundwater) has been well developed and applied in cooling and heating industrial and civilian constructions by making use of ground source heat pump (GSHP) technology [5, 6], which has been proved with the characteristics of effective, environmental friendly and multi-functional of buildings heating, cooling and dehumidifying [7,8], which is indeed one of the most fast growing clean energy utilizing air-conditioning technologies at present. By the end of 2005, the utilization scale of ground source heat

This study was supported by the earmarked fund for Modern Agro-industry Technology Research System (CARS-25-D-04)

Author: Lilong Chai, Ph.D of China Agricultural University, and Research Assistant in Vegetable Research Center, Beijing Academy of Agriculture and Forestry Sciences. Beijing 100097.

Corresponding author: Chengwei Ma, Ph.D, Professor, P.O.BOX 195, 17 Qinghua East Road, China Agricultural University (East campus), Beijing 100083.

pump air-conditioning in resident or office buildings had reached $3000 \times 10^4 \text{ m}^2$ in mainland China [9], and some research on GSHP technology in agricultural facilities cooling or heating were conducted in recent years [10,11].

Although the energy saving performance of GSHPs in greenhouse cooling or heating has been estimated in past studies with many methods [12-14], most of analysis were limited in first law of thermodynamics, which describes the heat quantity transfer process in GSHPs, such as the COP was calculated based on this method. However, the quality of energy utilizing was taken into consideration in Carnot Cycle based heat transferring process such as heat pump system [15]. The quality analysis of the energy was defined as Exergy analysis that is based on second law of thermodynamics and is the combination of Enthalpy and Entropy. Exergy can be described as the maximum amount of work that a thermodynamic system can achieved when it is reach equilibrium with the reference environment [16, 17]. Exergy analysis method has been utilized in various fields [18]. Dincer [12] has come up with that the potential usefulness of Exergy in addressing and solving environmental problems as well as attaining sustainable development is crucial. Ozgener and Hepbasli [19] have assessed the relations between thermodynamic losses and capital costs for devices, and suggested possible generalizations in the relation. Generally, the Exergy analysis method was proved to be a more comprehensive method in assessing the energy transferring [20, 21]. Therefore, the combined method of energetic and exergetic performances study on agricultural greenhouse cooling need to be built for the utilizing of GSHPs.

The objects of this study is but not limited to (1) build the energetic and exergetic performance estimating method and simulation models for agricultural greenhouse cooling with GSHPs. (2) presents GSHPs greenhouse cooling performances based on the theories of first and second laws of thermodynamics.

2. Materials and Methods

2.1 GSHP greenhouse cooling system

The GSHPs and tested greenhouse (Fig. 1) were located in the in Haidian district (latitude $39^{\circ}40' \text{ N}$) of Beijing of China. The GSHPs system had three principal circuits, as shown in Fig.2.

(i) Groundwater drawing and refilling part (there are five wells with the depth of about 100m, one water drawing well, four water refilling wells. The groundwater drawing and refilling circuit consisted of one water drawing well, four water refilling wells, a water drawing pump, and a water refilling pump. Each water pump had 11 kW rated input power and $33.2 \text{ m}^3 \text{ h}^{-1}$ maximum water flow rate. The distances between the drawing well and refilling wells ranged from 100 to 300 m;

(ii) GSHP energy enhancing circuit, which consisted of four Danfoss Hermetic scroll compressors connected in series. GSHP unit contained about 58 kg R22 refrigerant and had total capacity of 380 kW for heating and 450 kW for cooling, the rated power of the electric motor for each compressor was 16.08 kW;

(iii) Heat transportation and fan coil heating units. This circuit contains many water circulating pipes and two water pumps.



Fig.1 GSHPs and agricultural greenhouse in test.

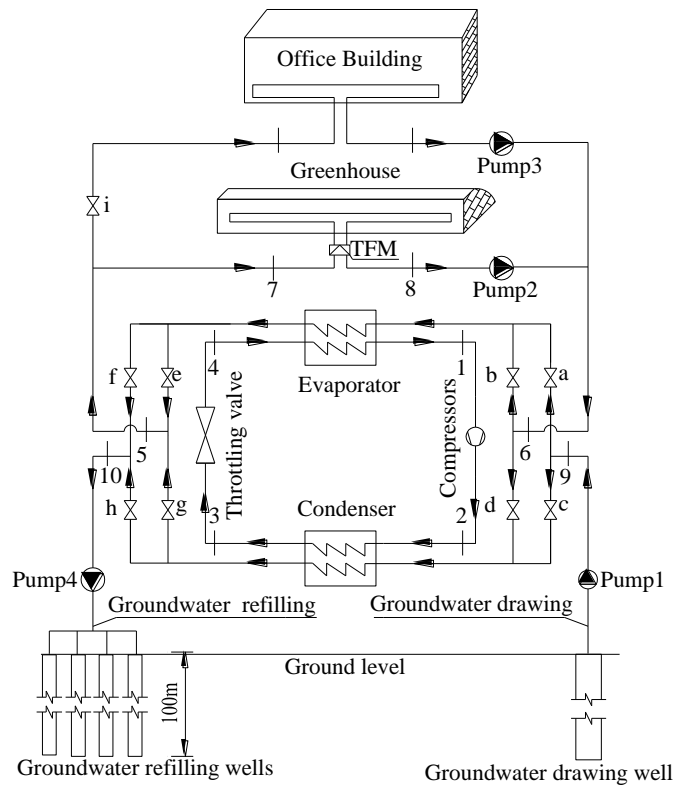


Fig.2 Schematic diagram of GSHP cooling system in the study, a–i are valves installed on different water pipes ; Pump1 represents the drawing water pumps; Pumps 2 and 3 represents circulating water pumps; Pump 4 represents backfilling water pumps; 1-10 represents each thermodynamic state position of refrigerant or water in each circle.

During summer cooling test, the GSHPs operated cooling cycle, the water valves of b, c, e and h were turned on, and keep the valves of a, d, f and g shut off. In groundwater circle, the groundwater was drawn out from the well and pumped into

heat exchanger connected with condenser via valve c, and then was recharged back via valve h to refilling wells after heat exchange in condenser. In greenhouse and building heating circle, the cold circulating water was sent to greenhouses and office buildings to cooling the house via valve e after released heat exchange in evaporator, and then was sent back via valve b to the heat exchanger connected with evaporator.

2.2 Energetic performance simulating models

The coefficient of performance (COP) was often used as indicator to analyze the GSHP system under cooling operation, which is an important index for evaluating the energy efficiency in a thermodynamics system. Referred to previous research [12, 21], the energy transfer and performance analytical model of the system can be put forwarded as Eqs. (1) - (7). The cooling COP of the GSHP unit, total system and greenhouse subsystem are analyzed in the study.

Groundwater,

$$Q_{\text{well}} = m_{\text{well}}(h_{10} - h_9) \quad (1)$$

Where, Q_{well} is the groundwater heat transfer rate in condenser, in kW; m_{well} is the mass flow rate of underground water, in kg s^{-1} ; h_9 is the specific enthalpy of underground water entering condenser, in kJ kg^{-1} ; h_{10} is the specific enthalpy of groundwater leaving condenser, in kJ kg^{-1} .

Condenser,

$$Q_{\text{cond}} = m_{\text{ref}}(h_{2e} - h_3) \quad (2)$$

Where, Q_{cond} is the heat rejection rate in the condenser, in kW; m_{ref} is the mass flow rate of refrigerant R22, in kg s^{-1} ; h_{2e} is the specific enthalpy of refrigerant leaving compressor/entering condenser in isentropic process, in kJ kg^{-1} ; h_3 is the specific enthalpy of refrigerant leaving condenser /entering throttling valve, in kJ kg^{-1} .

Evaporator,

$$Q_{\text{evap}} = m_{\text{ref}}(h_1 - h_4) \quad (3)$$

Where, Q_{evap} is the heat transfer rate in the evaporator, in kW; h_1 is the specific enthalpy of refrigerant leaving evaporator /entering compressor, in kJ kg^{-1} ; h_4 is the specific enthalpy of refrigerant leaving throttling valve /entering evaporator, in kJ kg^{-1} .

Compressor,

$$W_{\text{comp}} \eta_e \eta_c = m_{\text{ref}}(h_{2e} - h_1) \quad (4)$$

Where, W_{comp} is the power input to the compressors in kW; η_e is the compressor iso-entropy work efficiency; η_c is the compressor cubage work efficiency. In this study the product of η_e and η_c was considered as 75% as manufacturer rated.

Throttling valve,

$$Q_{\text{thro}} = m_{\text{ref}}(h_4 - h_3) \quad (5)$$

Where, Q_{thro} is the heat transfer rate in the throttling valve, in kW.

$$Q_{\text{cir}} = m_{\text{wa}}(h_6 - h_5) \quad (6)$$

Where, Q_{fc} is the total heat transfer rate of circulating water system, in kW; m_{wa} is the mass flow rate of circulating water, in kg s^{-1} ; h_5 is the specific enthalpy of circulating water leaving evaporator, in kJ kg^{-1} ; h_6 is the specific enthalpy of circular water entering evaporator, in kJ kg^{-1} .

Circulating water system via greenhouse,

$$Q_{fc,g} = m_{wa,g} (h_8 - h_7) \quad (7)$$

Where, $Q_{fc,g}$ is the cooling capacity of fan-coil units in greenhouse, in kW; $m_{wa,g}$ is the mass flow rate of circulating water in greenhouse, in kg s^{-1} ; h_7 is the specific enthalpy of flowing in water in greenhouse, in kJ kg^{-1} ; h_8 is the specific enthalpy of flowing out water in greenhouse, in kJ kg^{-1} .

The COP was usually applied as an indicator for assessing the performance of GSHPs in civilian and industry buildings heating and cooling research [17, 22]. The greenhouse heating COP of GSHPs was estimated with Eqs. (8) -(10).

$$\text{COP}_{\text{GSHP}} = \frac{Q_{\text{evap}}}{W_{\text{comp}}} \quad (8)$$

$$E_e = \sum_{i=1}^n \sum_{j=1}^m E_{i,j} \quad (9)$$

$$\text{COP}_{\text{sys}} = \frac{E_g}{3600E_e} \quad (10)$$

Where, $E_{i,j}$ is the electricity energy consumed by equipment j at time i , kWh, the electricity energy consuming equipment in greenhouse cooling including GSHP compressors, water pumps, and fan coil units; E_e is total electric energy consumed by GHSPs, kWh; E_g is cooling quantity in greenhouse provided by GHSPs, kJ; COP_{GSHP} is cooling COP of GSHP unit, dimensionless; COP_{sys} is greenhouse cooling COP of GSHPs, dimensionless.

2.3 Exergic performance simulating models

Exergy analysis is based on the second law of thermodynamics, which takes the entropy portion into consideration by including irreversibilities, and is the combination between enthalpy and entropy. Exergy reflects both quantity and quality of thermodynamic process [12, 13]. The Exergy efficiency (Ex_{dest}) and Exergy destruction rate (ε) are core content of Exergy analysis, which was applied in this study to demonstrate the performance of GSHPs in greenhouse and buildings cooling. The estimation of Exergy transferring in each section of GSHPs was conducted with Eqs. (11)- (17).

Compressor,

$$ex_2 - ex_1 = (h_{2i} - h_1) - T_0 (s_{2i} - s_1) \quad (11)$$

Condenser,

$$ex_2 - ex_3 = (h_{2i} - h_3) - T_0 (s_{2i} - s_3) \quad (12)$$

Throttle valve,

$$ex_3 - ex_4 = (h_3 - h_4) - T_0 (s_3 - s_4) \quad (13)$$

Evaporator,

$$ex_4 - ex_1 = (h_4 - h_1) - T_0(s_4 - s_1) \quad (14)$$

Heat exchanger of circulating water and evaporator,

$$ex_5 - ex_6 = (h_5 - h_6) - T_0(s_5 - s_6) \quad (15)$$

Heat exchanger of circulating water and greenhouse fan-coil units,

$$ex_7 - ex_8 = (h_7 - h_8) - T_0(s_7 - s_8) \quad (16)$$

Heat exchanger of groundwater and condenser,

$$ex_9 - ex_{10} = (h_9 - h_{10}) - T_0(s_9 - s_{10}) \quad (17)$$

Where, $ex_{1\sim 10}$ represent the specific Exergy at each position of 1~10 in Fig.2, in kJ kg^{-1} ; $h_{1\sim 10}$ are the specific enthalpy at each position of 1~10, respectively, in kJ kg^{-1} ; $s_{1\sim 10}$ are the specific entropy at each position of 1~10, respectively, in $\text{kJ kg}^{-1} \text{K}^{-1}$.

2.3.1 Exergy destruction rate

Exergy destruction rate embodies the quantity of devalued energy [13, 22], which was estimated with Eqs. (18) - (23) in each section of GSHPs.

Compressor,

$$Ex_{\text{dest,comp}} = W_{\text{comp}} - m_{\text{ref}}(ex_2 - ex_1) \quad (18)$$

Condenser,

$$Ex_{\text{dest,cond}} = m_{\text{ref}}(ex_9 - ex_{10}) - m_{\text{ref}}(ex_3 - ex_2) \quad (19)$$

Throttle valve,

$$Ex_{\text{dest,thro}} = m_{\text{ref}}(ex_3 - ex_4) \quad (20)$$

Evaporator,

$$Ex_{\text{dest,evap}} = m_{\text{ref}}(ex_4 - ex_1) - m_{\text{ref}}(ex_6 - ex_5) \quad (21)$$

Groundwater circle,

$$Ex_{\text{dest,gw}} = Q_{\text{well}} \left(1 - \frac{T_{10}}{T_0}\right) - m_{\text{well}}(ex_{10} - ex_9) \quad (22)$$

Heat transportation circle,

$$Ex_{\text{dest,cir}} = Q_{\text{evap}} \left(1 - \frac{T_5}{T_0}\right) - m_{\text{cir,w}}(ex_5 - ex_6) \quad (23)$$

Where, $Ex_{\text{dest,comp}}$, $Ex_{\text{dest,evap}}$, $Ex_{\text{dest,cond}}$, $Ex_{\text{dest,thro}}$, $Ex_{\text{dest,cir}}$ are exergy destruction rate in compressor, evaporator, condenser, throttling valve, circulating water system, respectively, dimensionless. T_5 , T_6 , T_9 are water temperatures at positions 5, 6 and 9, respectively, in K.

2.3.2 Exergy efficiency

The Exergy efficiency of various sections and total system of GSHPs were estimated with the Eqs. (24)- (30).

Compressor,

$$\varepsilon_{\text{comp}} = \frac{Ex_2 - Ex_1}{W_{\text{comp}}} \quad (24)$$

Throttle,

$$\varepsilon_{\text{thro}} = \frac{Ex_3 - Ex_4}{W_{\text{comp}}} \quad (25)$$

Evaporator,

$$\varepsilon_{\text{evap}} = 1 - \frac{E_{\text{dest,eva}}}{W_{\text{comp}}} \quad (26)$$

Condenser,

$$\varepsilon_{\text{cond}} = 1 - \frac{E_{\text{dest,cond}}}{W_{\text{comp}}} \quad (27)$$

Circulating water system,

$$\varepsilon_{\text{cir}} = 1 - \frac{E_{\text{dest,cir}}}{W_{\text{fc}} + W_{\text{pump,cir}}} \quad (28)$$

GSHP unit,

$$\varepsilon_{\text{hp}} = 1 - \frac{\frac{Ex_{\text{dest,evap}} + Ex_{\text{dest,comp}} + Ex_{\text{dest,thro}} + Ex_{\text{dest,cond}}}{\frac{Ex_{\text{dest,evap}}}{1 - \varepsilon_{\text{evap}}} + \frac{Ex_{\text{dest,comp}}}{1 - \varepsilon_{\text{comp}}} + \frac{Ex_{\text{dest,thro}}}{1 - \varepsilon_{\text{thro}}} + \frac{Ex_{\text{dest,cond}}}{1 - \varepsilon_{\text{cond}}}}}{1 - \varepsilon_{\text{hp}}} \quad (29)$$

GSHP system,

$$\varepsilon_{\text{sys}} = 1 - \frac{\frac{Ex_{\text{dest,evap}} + Ex_{\text{dest,comp}} + Ex_{\text{dest,thro}} + Ex_{\text{dest,cond}} + Ex_{\text{dest,cir}}}{\frac{Ex_{\text{dest,evap}}}{1 - \varepsilon_{\text{evap}}} + \frac{Ex_{\text{dest,comp}}}{1 - \varepsilon_{\text{comp}}} + \frac{Ex_{\text{dest,thro}}}{1 - \varepsilon_{\text{thro}}} + \frac{Ex_{\text{dest,cond}}}{1 - \varepsilon_{\text{cond}}} + \frac{Ex_{\text{dest,cir}}}{1 - \varepsilon_{\text{cir}}}}}{1 - \varepsilon_{\text{sys}}} \quad (30)$$

Where, $\varepsilon_{\text{comp}}$, $\varepsilon_{\text{evap}}$, $\varepsilon_{\text{cond}}$, $\varepsilon_{\text{thro}}$, ε_{cir} , ε_{hp} , ε_{sys} are Exergy efficiencies of the compressor, evaporator, condenser, throttle, circulating water system, GSHP unit and GSHP system respectively, dimensionless.

2.4 Data acquisition

The following data was collected in this test,

- (1) Measuring mass flow rates of the water by using rotameters (Beijing jingyuan liquid apparatus company, China). Rotameters were installed at inlet of all water flow tubes;
- (2) Measuring the temperature of the water inlet and outlet of the condenser, evaporator, and the greenhouse by using resistance thermometers PT1000 (Jingyuan liquid apparatus company, China, error limitation is $\pm (0.3 + 0.005 \Delta t \text{ } ^\circ\text{C})$), each couple of thermometers were installed at inlet and outlet of water flow respectively;

- (3) Measuring the temperature and humidity of air inside and outside of greenhouse by using temperature–humidity sensors RS–11 (ESPEC, Japan), the error limitation is ± 0.5 °C in temperature and $\pm 5\%$ in relative humidity;
- (4) Recording input power of different electric motor driving equipments by using ammeters (Shanghai Huaxia ammeters manufactory).

All the simulation calculation was conducted in Micro-soft Excel file. The results was calculated by following assumptions (i) The temperature at 1, 2, 3 and 4 points in GSHP unit was gained from manufacturer (*Chongke High–Technology Development Co.,Ltd, Beijing,China*), and assumed that the running was kept on steadily, as well as the temperature at 1,2,3 and 4 points. (ii) In this study, the restricted dead state was taken to be the state of environment, the temperature and the atmospheric pressure are 0 °C and 101.325 kPa, and don't take the Exergy destruction of water pumps and pressure change into account for the limited condition.

3 Results and Discussion

3.1 The Energetic performance of GSHPs

For a great deal of water was needed for staff living and farm irrigation at experiment station in summertime, the pumped underground water were not backfilled into well during the test, and the Pump3 was not used in fact, so neglecting the effect of Pump3 and backfilled well. The refrigeration capacity of evaporator Q_{evap} is 190kW, and the actual heat transfer rate between evaporator and circular water system was 164.15kW on average according to the calculation based on the measurements made during Aug.13–18th, 2007, the power input is 53.32kW. Besides, the refrigeration capacity rate to greenhouse during test is 40.18 kW on average. Detailed information about the energy input and COP calculated results as shown in Table 1. The greenhouses cooling COP with GSHPs is 3.09, which is higher than air source heat pumps of 2.0 by more than 50% [22].

Table 1 Cooling performance of the GSHPs in greenhouse (Aug.13-18, 2007)

Parameters	GSHPs-Greenhouse section	GSHPs-whole system
Fan-coil unit cooling rate, kW	40.2	157.2
Heat exchanging rate of Groundwater, kW	-	131.7
Compressors energy input rate, kW	8.1	32.2
Water pumps energy input rate, kW	4.6	18.5
Total energy input rate, kW	13.0	53.3
COP of Heat pump unit	-	5.90
COP of GSHPs	3.09	2.95

3.2 Exergetic performances

Exergy analysis reflect the quality and quantity of a thermodynamic system, it is closely connected with each element of GSHP system, including compressor, evaporator, condenser and throttle valve. Exergy efficiencies and Exergy destruction are two of important indexes for evaluating energy utilizing system. The state of

circulating water, groundwater and R-22 refrigerant was monitored or calculated according the test during Aug.13-18, 2007, as shown in Table 2.

Table 2 State parameters of Liquids in system (Aug.13–18th, 2007)

Positions	Liquids	Mass flow rate m , kg s^{-1}	Temperature t , $^{\circ}\text{C}$	Specific enthalpy h , kJ kg^{-1}	Specific entropy s , $\text{kJ kg}^{-1} \text{K}^{-1}$
1	R22 refrigerant in vapor	1.145	10.0	409	1.738
2	R22 refrigerant in vapor	1.145	65.0	430	1.738
3	R22 refrigerant in Liquid	1.145	35.0	243	1.146
4	R22 refrigerant in mixture of vapor and liquid	1.145	3.0	243	1.158
5	Total circulating water	15.03 3	10.1 \pm 0.50	42	0.152
6	Total circulating water	15.03 3	12.7 \pm 0.55	53	0.190
7	Greenhouse inlet circulating water	0.923	10.2 \pm 0.48	43	0.154
8	Greenhouse outlet circulating water	0.923	20.8 \pm 0.83	88	0.305
9	Groundwater	9.220	14.1	59	0.211
10	Groundwater	9.220	17.6	74	0.261

Note, The state parameters value at different thermodynamic positions was calculated according to the recorded data during the test and published value [12, 22, 23] under rated compressor summer operating efficiency of 75%.

In Exergetic performance simulating, the reference temperature T_o was set as averaged outdoor air temperature 306.25. The Exergetic performances including of Exergy destruction rate and Exergy efficiency of GSHPs were listed in Table 3. In GSHPs, the section of evaporator shows highest Exergy efficiency of 92.5, which indicates that this section has higher energy utilizing quality. The condensers Exergy efficiency is about 65.8%. According to the Ozgener [22] reported result, the condenser has the Exergy efficiency of 80.5% when the GSHPs in heating mode, and 28.6% for evaporator. Therefore, the conclusion of higher Exergy efficiency for condenser and lower Exergy efficiency for evaporator in winter heating mode, and lower Exergy efficiency for condenser and higher Exergy efficiency for evaporator in summer cooling mode could be given.

Table 3 Exergetic performances (Aug.13-18th, 2007)

Elements	Exergy destruction rate, kW	Exergy destruction efficiency, %	Exergy efficiency, %
Compressor	8.14	25.3	74.7
Evaporator	1.83	7.5	92.5
Throttle valve	11.22	-	-
Condenser	5.84	34.2	65.8
Circulating water system	6.26	61.7	38.3
GSHP unit	27.03	42.0	58.0
GSHP system	33.29	64.0	36.0

Throttling valve consist of many capillaries, the Exergy destruction rate was high theoretically. As the R22 passing throttling valve was considered as adiabatic process, so the destruction of Exergy of R22 was caused by the increase of Entropy. Besides, as there no energy input in throttle valve, so the Exergy efficiency of throttling valve could be positive infinity or negative infinity, the study on it is insignificance. If the throttle valve was replaced with Expansion valve, the Entropy increase of R22 would be declined, but the cost of GSHPs would increase. The key object of energetic and exergetic performance analysis is to balance the relationship between economics and thermodynamics.

Generally, the total Exergy efficiency of GSHPs in greenhouse cooling is 36%, which is higher than published value of 15% [23] in residential buildings cooling. However, the Exergy efficiency of GSHPs in this study has the potential to be improved by reducing the Exergy destruction of water circulating and fan-coil units operating.

4. Conclusions

The following conclusions were drawn based on the results in this study,

1) The Energetic and Exergetic simulation models and performance evaluating method were built in this study for greenhouse GSHPs performance analysis;

2) According to simulated results, total Exergy efficiency of GSHPs in greenhouse cooling is 36%, which is higher than published value of 15% in residential buildings cooling. The Exergy efficiency of GSHPs in this study has the potential to be improved by reducing the Exergy destruction of water circulating and fan-coil units operating.

3) The Energetic and Exergetic performances of GSHPs are associated with the economical performance closely, the optimizing of the Exergy reversibility and COP usually at the cost of economic performance degradation. The key object of energetic and exergetic performance analysis is to balance the relationship between economics and thermodynamics.

Acknowledgments This study was supported by the earmarked fund for Modern Agro-industry Technology Research System (CARS-25-D-04)

References

1. Zheng D (2004). Modeling of standing column well in ground source heat pump system. Ph.D Thesis, Oklahoma State University, Stillwater
2. Mao H., Wang X., Wang D (2004). The design and test of greenhouse solar energy heating system[J]. *Acta Energiæ Solaris Sinica*, 25 (3), 305–309 (in Chinese)
3. Michopoulos, A (2007). Three-years operation experience of a ground source heat pump system in Northern Greece. *Energy and Buildings*, 39, 328–334
4. Ptasiński, J., Prins, M J., Pierik, A (2007). Exergetic evaluation of biomass gasification. *Energy*, 32, 568–574
5. Zeng H., Diao N., Fang Z (2002). A finite line-source model for boreholes in geothermal heat exchangers. *Transfer—Asian Research*, 31(7), 558–567
6. Hamada Y., Nakamura M., Saitoh H., et al (2007). Improved underground heat exchanger by using no-dig method for space heating and cooling [J]. *Renewable Energy*, 32(3), 480–495
7. Li X., Chen Z., Zhao J (2006). Simulation and experiment on the thermal performance of U-vertical ground coupled heat exchanger. *Applied Thermal Engineering*, 26, 1564–1571
8. Karlsson, F., Fahlén P (2007). Capacity-controlled ground source heat pumps in hydronic heating systems. *International Journal of Refrigeration*, 30, 221–229
9. Xu W (2006). Investigation and analysis on utilization of ground source heat pump in China. *Construction and Design for Project*, 12, 16–19
10. Chai L., Ma C., Zhang Y., et al (2010). Energy consumption and economic analysis of ground source heat pump used in greenhouse in Beijing. *Transactions of the CSAE*, 26(3), 249–254
11. Fang H., Yang Q., Sun J (2008). Application of ground-source heat pump and floor heating system to greenhouse heating in winter. *Transactions of the CSAE*, 24(12), 145–149
12. Dincer, I (2002). The role of Exergy in energy policy making. *Energy Policy*, 30, 137–149
13. Sciubba, E., Ulgiati, S (2005). Emergy and Exergy analysis, Complementary methods or irreducible ideological options. *Energy*, 30, 1953–1988
14. Winter, C-J (2007). Energy efficiency, no, It's Exergy efficiency. *International Journal of Hydrogen Energy*, 32, 4109–4111
15. Miu D (2002). *Refrigeration Compressor*. Beijing, China Machine Press (in Chinese)
16. Zhang J (1999). *Brief Manual for Air Conditioning Worker*. Beijing, China Machine Press (in Chinese)
17. Yan J., Wang Y (2001). *Engineering Thermodynamics* (third edition). Beijing: Higher Education Press
18. Som, K., Datta A (2008). Thermodynamic irreversibilities and Exergy balance in combustion. *Progress Energy Combustion Science*, 34 (3), 351–376
19. Ozgener, O., Hepbasli, A (2005). Exergoeconomic analysis of a solar assisted ground-source heat pump greenhouse heating system. *Applied Thermal Engineering*, 25, 1459–147
20. Bisio, G., Rubatto, G (2002). Work and entropy production aspects of irreversible processes in closed and steady-state open systems. *Exergy, an International Journal*, 2, 192–205
21. Ebru, K A., Hepbasli A (2007). A comparative study on exergetic assessment of two ground-source (geothermal) heat pump systems for residential applications. *Building and Environment*, 42, 2004–2013
22. Ozgener, O., Hepbasli, A (2007). A parametrical study on the energetic and exergetic assessment of a solar-assisted vertical ground-source heat pump system used for heating a greenhouse. *Building and Environment*, 42, 11–24
23. Zhao H., Yang Z (2004). The thermodynamic analysis of water source heat pump. *Energy Conservation Technology*, 22(3), 29–32 (in Chinese)